



# IDI – Commercial II: Legends

## Sample Ceiling Legends:

### REFLECTED CEILING PLAN LEGEND

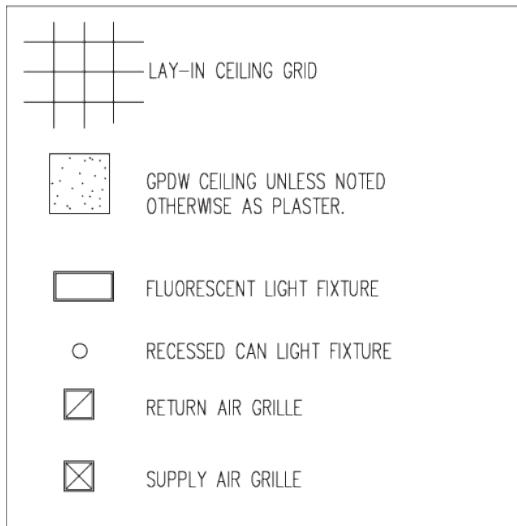

or

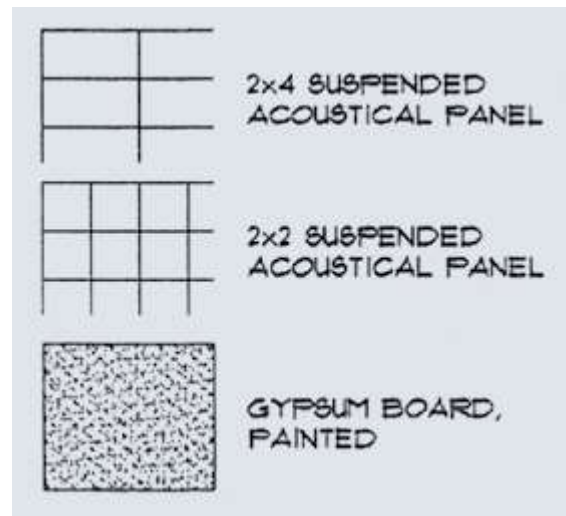

**Sample Lighting Legend** – Your legend should only include symbols found on your plan!

LIGHTING LEGEND	
F1	RECESSED DIRECT/INDIRECT 2'x4' FLUORESCENT LIGHT FIXTURE/(3) T8 LAMPS PER FIXTURE LITHONIA "AVANTI" WITH PERFORATED METAL DIFFUSER
F2	[NOT USED]
F3	[NOT USED]
F4	SUSPENDED LINEAR INDIRECT LIGHT FIXTURE (3) T8 LAMPS PER FIXTURE/7'-0" TO UNDERSIDE OF FIXTURE/REF. PLAN FOR OVERALL LENGTH PEERLITE "PRIMA" WITH "LIGHTVENT" PERFORATED PATTERN
F5	WALL MOUNTED LINEAR INDIRECT LIGHT FIXTURE (3) T8 LAMPS PER FIXTURE/7'-0" TO UNDERSIDE OF FIXTURE/REF. PLAN FOR OVERALL LENGTH PEERLITE "CERRA WALL" WITH PERFORATED METAL PATTERN TO MATCH LIGHT FIXTURE TYPE F4
F6	RECESSED COMPACT FLUORESCENT LIGHT FIXTURE TRIM FOR LAY-IN CEILING TILE
F6A	RECESSED COMPACT FLUORESCENT LIGHT FIXTURE TRIM FOR DRYWALL CEILING
F7	[NOT USED]
F8	WALL MOUNTED INCANDESCENT LIGHT FIXTURE REF. ELEVATIONS FOR LOCATION AND HEIGHT
F9	RECESSED INCANDESCENT LIGHT FIXTURE TRIM FOR LAY-IN CEILING
F9A	RECESSED INCANDESCENT LIGHT FIXTURE TRIM FOR DRYWALL CEILING
F10	RECESSED INCANDESCENT WALL WASH FIXTURE TRIM FOR LAY-IN CEILING
F10A	RECESSED INCANDESCENT WALL WASH FIXTURE TRIM FOR DRYWALL CEILING
EX	EXISTING LIGHT FIXTURE TO REMAIN
F11	RECESSED LENSED 2'x4' FLUORESCENT LIGHT FIXTURE – KITCHEN AND SERVERY
F12	RECESSED LENSED COMPACT FLUORESCENT LIGHT FIXTURE – SERVERY TRIM FOR LAY-IN CEILING TILE
F12A	RECESSED LENSED COMPACT FLUORESCENT LIGHT FIXTURE – SERVERY TRIM FOR DRYWALL CEILING
F13A	RECESSED LENSED WALL WASH FIXTURE – SERVERY TRIM FOR DRYWALL CEILING
F14	SURFACE MOUNTED INCANDESCENT LIGHT FIXTURE – SERVERY
F15	PENDANT INCANDESCENT LIGHT FIXTURE – WORK SPACE SHOW ROOM EUREKA E4210-LC-H WITH CHROME STEM AND WHITE SHADE (1) 50W MR16 LAMP
F16	PENDANT INCANDESCENT LIGHT FIXTURE – WORK SPACE SHOW ROOM ARTEMIDE CREONE SUSPENSION
F17	SURFACE MOUNTED TRACK LIGHT WITH GIMBAL RING HEADS/PAR 30 LAMPS – WHITE TRACK WITH METALLIC GIMBAL RING – REF. CEILING PLANS FOR LENGTH AND QUANTITY OF TRACK HEADS
F18	PENDANT INCANDESCENT LIGHT FIXTURE – WORK SPACE SHOW ROOM ARTEMIDE CYCLOS SUSPENSION
F19	COLD CATHODE LIGHTING – REF. CEILING PLAN FOR RADIUS – WORK SPACE SHOW ROOM
F20	UNDERCABINET FLUORESCENT TASK LIGHT

## How does a Partition Schedule work on your plan?

- Select wall type(s) from the list below to create a schedule for your project.
- Number your wall types in sequence placing the number inside the diamond.
- On your floor plan place the appropriate numbered diamond at the wall condition.
- This Partition Schedule should be located on your floor plan(s).
- Follow layout planning as taught in **CAD I**.

PARTITION SCHEDULE:	
1	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" GYPSUM BOARD EACH SIDE, TO UNDERSIDE OF DECK. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
2	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" GYPSUM BOARD EACH SIDE, TO MINIMUM 4" ABOVE CEILING. BRACE TO STRUCTURE ABOVE • 4'-0" O.C.
3	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE ON TOILET ROOM SIDE, AND 5/8" GYPSUM BOARD OTHER SIDE. EXTEND PARTITION TO MINIMUM 4" ABOVE CEILING. BRACE TO STRUCTURE ABOVE • 4'-0" O.C.
4	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, ONE SIDE. EXTEND PARTITION TO MINIMUM 4" ABOVE CEILING. BRACE TO STRUCTURE ABOVE • 4'-0" O.C.
5	3/8" GYPSUM BOARD, LAMINATED TO EXISTING WALL SURFACE. EXTEND MINIMUM 4" ABOVE CEILING. WHERE NEW CEILINGS ARE SCHEDULED.
6	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, ON TOILET ROOM SIDE, AND 5/8" GYPSUM BOARD OTHER SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
7	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" GYPSUM BOARD ONE SIDE, TO MINIMUM 4" ABOVE CEILING. BRACE TO STRUCTURE ABOVE • 4'-0" O.C.
8	STEEL STUD INFILL • 16" O.C. WITH 5/8" GYPSUM BOARD EACH SIDE, MATCH THICKNESS OF EXISTING WALL. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
9	STEEL STUD INFILL • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE ON TOILET ROOM SIDE, AND 5/8" GYPSUM BOARD OTHER SIDE. MATCH THICKNESS OF EXISTING WALL. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
10	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, EACH SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
10	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, EACH SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. FILL ALL VOIDS WITH SOUND ATTENUATION BATTS.
11	5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, LAMINATED TO EXISTING WALL SURFACE. EXTEND TO MINIMUM 4" ABOVE CEILING.
12	6" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" GYPSUM BOARD ABOVE, BOTH SIDES. EXTEND PARTITION TO MINIMUM 4" ABOVE CEILING. BRACE TO STRUCTURE ABOVE • 4'-0" O.C.
13	3 5/8" STEEL STUDS • 16" O.C. WITH (2) LAYERS 5/8" "TYPE X" GYPSUM BOARD EACH SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. PROVIDE SOUND ATTENUATION BATTS IN ALL PARTITION CAVITIES AND FIRESAFING MATERIAL IN ALL VOIDS & PENETRATIONS. PARTITION TO HAVE TWO-HOUR FIRE RATING EQUIVALENT TO U.L. DESIGN NO. U411 (2-HOUR).
14	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" "TYPE X" GYPSUM BOARD EACH SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. PROVIDE SOUND ATTENUATION BATTS IN ALL PARTITION CAVITIES AND FIRESAFING MATERIAL IN ALL VOIDS & PENETRATIONS. PARTITION TO HAVE 1-HOUR FIRE RATING EQUIVALENT TO U.L. DESIGN NO. U419 (1-HOUR).
15	STEEL STUD INFILL • 16" O.C. WITH 5/8" "TYPE X" GYPSUM BOARD EACH SIDE. MATCH THICKNESS OF EXISTING WALL. PROVIDE SOUND ATTENUATION BATTS IN ALL STUD CAVITIES AND FIRESAFING MATERIAL IN ALL VOIDS AND PENETRATIONS. PARTITION TO HAVE ONE HOUR FIRE-RATING EQUIVALENT TO U.L. DESIGN NO. U419 (1-HOUR).
16	3 5/8" STEEL STUDS • 16" O.C. WITH 5/8" CEMENT BOARD TO 4'-0" AFF. & 5/8" "TYPE X" GYPSUM BOARD ABOVE ON TOILET ROOM SIDE AND 5/8" "TYPE X" GYPSUM BOARD OTHER SIDE. EXTEND PARTITION TO UNDERSIDE OF DECK. PROVIDE SOUND ATTENUATION BATTS IN ALL PARTITION CAVITIES AND FIRESAFING MATERIAL IN ALL VOIDS & PENETRATIONS. PARTITION TO HAVE 1-HOUR FIRE RATING EQUIVALENT TO U.L. DESIGN NO. U419 (1-HOUR).

## Sample Partition/Wall Legend

WALL LEGEND	
	EXISTING CONSTRUCTION TO REMAIN
	EXISTING 1-HR RATED PARTITION
	NEW PARTITION TO 6" ABOVE CEILING

Typical types of walls.